



INFORSE-Europe Sustainable Energy NGO Seminar

European Green Capital, Hamburg, Germany
August 22-26, 2011

Folie 1




INFORSE Europe
Sustainable Energy Seminar 23.08.2011



Feed-in of solar thermal energy into a district heating network


Dipl.-Ing., Dipl.-Wirtschafts-Ing. Karl-Friedrich Henke

Folie 2




Content

1. Overview of the E.ON Hanse Wärme GmbH
2. Renewable energies in the heating market
3. Long-term thermal storage: example Hamburg-Karlshöhe
4. Overcoming of technical obstacles of the solar thermal energy: project 'multifunctional storage'
5. Overcoming of economical obstacles of the solar thermal energy (pilot project Hamburg)
6. Prospect



Selle 2

Folie 3



Company

E.ON Hanse Wärme GmbH is the major branch company of this nature in the E.ON regional area.

Company data 2010:

Balance-sheet total	211 m €
Net sales	137 m €
Investments	15 m €
Employees	180
Heat production	1.625 GWh
Power generation in CHP	260 GWh
Plants	ca. 900
Heating networks	ca. 120
Cogeneration (CHP) plants	ca. 150

Selle 3

Folie 4

e-on | Hanse Wärme Qualifikations and memberships



- Integrated quality-, health- and safety protection management system DIN EN ISO 9001 / 14001 and OHSAS 18001, certified 2003...2012



Wirtschaft und Politik für unsere Zukunft



- Environmental partnership Hamburg since 2003
- Health and safety protection partnership Hamburg since 2005

Seite 4

Folie 5

e-on | Hanse Wärme Content

1. Overview of the E.ON Hanse Wärme GmbH
2. Renewable energies in the heating market
3. Long-term thermal storage: example Hamburg-Karlshöhe
4. Overcoming of technical obstacles of the solar thermal energy: project 'multifunctional storage'
5. Overcoming of economical obstacles of the solar thermal energy (pilot project Hamburg)
6. Prospect

Seite 5

Folie 6

e-on | Hanse Wärme Chances for renewable energies - the heating market


Heat generation from renewable energies [TWh]	1997	2007	2009
Biomass	48.6	84.2	95.7
Biogenic share of domestic waste	2.3	4.8	5.1
Solar thermal energy [13 Mio. m ²]	0.7	3.7	4.8
Geothermal energy	1.3	2.3	5.0

BMW Energie Daten, Tab. 20

- The share of the renewable energies rose in 2009 up to **8.4%**, growth rate 1.0% p.a., tendency rising
- The fuel 'wood' dominates the position 'biomass'
- Only the biogenic share of domestic waste is important for the public district heating supply.


Seite 6

Folie 7

 Primary energy effort of district heating (Germany)		
<p>The district heating market is (not yet) a market for biomass and renewable energies</p>		
Primary energy effort of district heating supply	2006	2009
<small>[BMWi Energiedaten Tab. 25]</small>		
Hard coal	21.1%	22.3%
Brown coal	7.1%	7.5%
Mineral oil	1.9%	2.1%
Natural gas	48.8%	47.2%
Waste etc.	21.1%	21.0%


Seite 7

Folie 8

 Heating network feeding 2006...2010						
	2010	2009	2008	2007	2006	Share
	[GWh]	[GWh]	[GWh]	[GWh]	[GWh]	2010
Biomass CHP	56,9	39,8	27,4	16,4	3,8	3,5%
Wood	8,1	10,2	12,1	5,8	5,2	0,5%
Landfill gas CHP	1,5	1,3	1,4	0,9	0,3	0,1%
Solar	0,0	0,0	0,2	0,4	0,4	0,0%
Industrial waste heat	1,5	1,9	4,6	6,7	7,9	0,1%
Sum renewables	68,0	53,0	45,6	30,2	17,6	4,2%
Waste combustion CHP	265,5	270,1	257,7	274,9	245,4	16,3%
Natural gas CHP	370,0	373,8	400,2	369,7	355,6	22,8%
Natural gas CHP, partners	12,3	10,5				0,8%
Coal CHP, partners	31,7					1,9%
Natural gas, boiler firing	877,6	889,8	834,2	802,1	1.074,7	54,0%
Heating networks feed-in	1.625,0	1.597,3	1.537,7	1.476,9	1.693,3	100,0%


Seite 8

Folie 9

 Biogas heating in district heating supply of E.ON Hanse Wärme			
Heating supply	until 2010	2011	2012
Number of heating supplies by external biogas-CHP	8	10	12
Electrical power output	5.0 MW	6.2 MW	6.5 MW
Biogas supply (Biogas 52% CH₄)			
Own biogas CHP plants running	9	21	25
Electrical power output	5.4 MW	10.7 MW	13.0 MW
Bio natural gas feed-in to natural gas grid			
Plants		1	2
Capacity (99% CH ₄)		350 m ³ /h	700 m ³ /h
Electrical power output		1.0 MW	2.5 MW

Seite 9

Folie 10

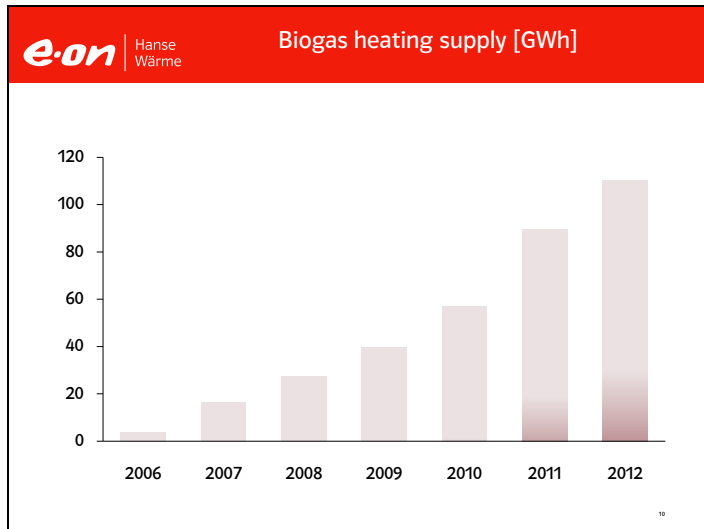

Folie 11


e-on | Hanse Wärme

Content

1. Overview of the E.ON Hanse Wärme GmbH
2. Renewable energies in the heating market
3. Long-term thermal storage: example Hamburg-Karlshöhe
4. Overcoming of technical obstacles of the solar thermal energy: project 'multifunctional storage'
5. Overcoming of economical obstacles of the solar thermal energy (pilot project Hamburg)
6. Prospect

Seite 11

Folie 12

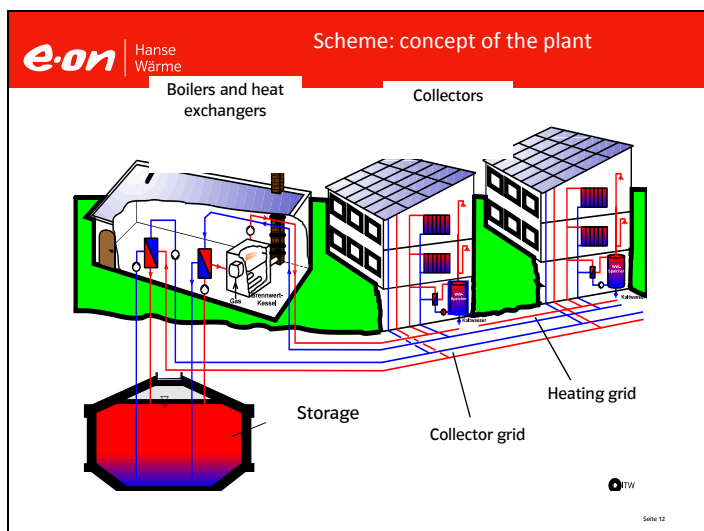

Folie 13



Folie 14



Folie 15

Conclusion: solar supported local heating with long-term thermal storage in Hamburg-Bramfeld:

- The solar heat production of 309 kWh / m² in the 5-years-average was within the expected range.
- Solar heat production: 905 MWh in average. Heat losses of the storage system: 400 MWh (!)
- The solar variable gross margin of the heat demand was between 25 and 26%. The heat losses of the storage system were generally too high.
- The combination between 3.000 m² collector surface und 4.500 m³ storage volume proved it's value.
- Due to temperature-related stretching and several changes of load (day to night), the collector network is unuseable and has to be replaced.

e-on | Hanse Wärme Content

1. Overview of the E.ON Hanse Wärme GmbH
2. Renewable energies in the heating market
3. Long-term thermal storage: example Hamburg-Karlshöhe
4. Overcoming of technical obstacles of the solar thermal energy: project 'multifunctional storage'
5. Overcoming of economical obstacles of the solar thermal energy (pilot project Hamburg)
6. Prospect

Seite 16

e-on | Hanse Wärme The future: multifunctional storage ± 10 MW

Schnitt A-A

Speichervolumen V = 4150 m³
 d = 23 m Innendurchmesser
 h = 12,2 m Wasserhöhe
 T = 80°C Drucklose

Steel tank 4.150 m³

Thermal insulation

Weight sole

Cross-section


e-on | Hanse Wärme Map of the area: Gut Karlshöhe

Multifunctional heat storage

Glass energy house

Exhibition

Folie 19

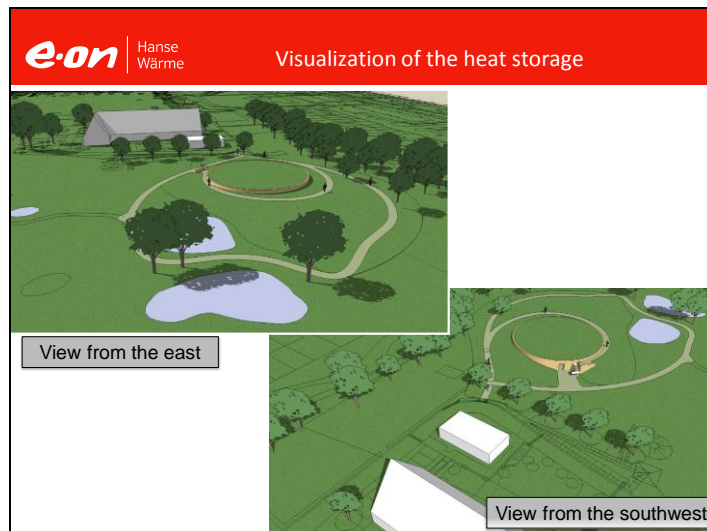

Folie 20



Folie 21

Solar thermal energy is not predictable

The solar energy feed-in causes rising temperatures of the water flow.
Countermeasures:

- First, the fossil fired production capacities are getting reduced, followed by the cogeneration capacities.
- If the total heat demand is less than 10 MW, e.g. on hot summer days, the storage will be charged with a maximum of 10 MW and discharged after sunset.
- We are striving for a combination between forward and return pipe network feed-in. The lowest rotation water amount in the network is controlled via bypass at a suitable point.

S. 21

Folie 22

e-on | Hanse Wärme Network concept

Solar thermal energy leads to material stress.

The collector network is stressed by temperature changes from day to night; the pipe material will be altered.

Countermeasures:

- The temperature in the collector circle gets limited to 100 °C by variable volume flow rates.
- The feed-in into the heating network can occur when the temperature in the collector circle is above the temperature of the network.

Seite 22

Folie 23

e-on | Hanse Wärme Network concept

Solar thermal energy is expensive

Countermeasures:

- Good locations and roof directions are preferred for the solar collectors. The common buildings in the network area are multiple-family houses with 4 to 8 floors and a flat roof.
- The collectors and heat exchangers should be standardised.
- In addition to the delivery from the district heating, a second heat exchanger with feed-in heat-measurement will be installed.
- Expensive installations for heat storage within the buildings cease to apply.
- The network-using concept allows to allocate the solar heat of one or several solar collector systems at a withdrawal point.

Seite 23


Folie 24

e-on | Hanse Wärme Elements of the project


- The long-term thermal storage has been developed into a multifunctional storage capable for temperature up to 100 °C. The new cover of stainless steel and the new thermal insulation are designed for a technical life-cycle of 50 years.
- The storage is connected by a 3 km extension to the district heating system Hamburg-East (120 MWh / 400 MWh). The maximum storage capacity is 240 MWh (10 MW / 24 hrs.)
- The combined network is connected to several area networks which simplifies the hydraulic integration of the solar collectors.
- Heat from solar collectors, renewable energies and surplus heat from CHP plants can be stored.

Seite 24

Folie 25

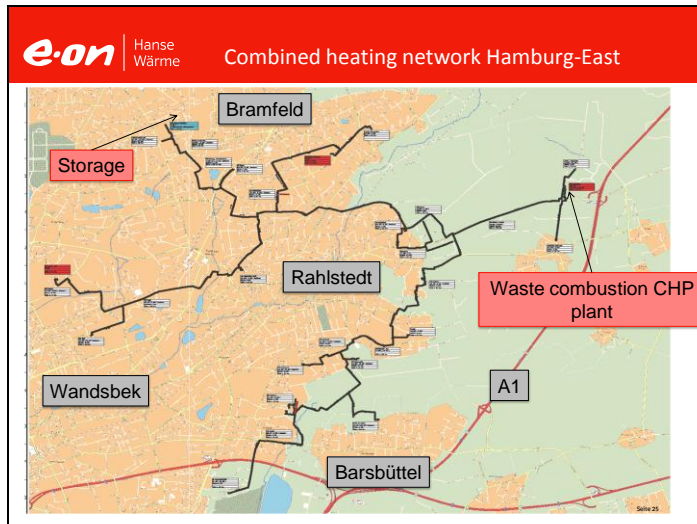

Folie 26

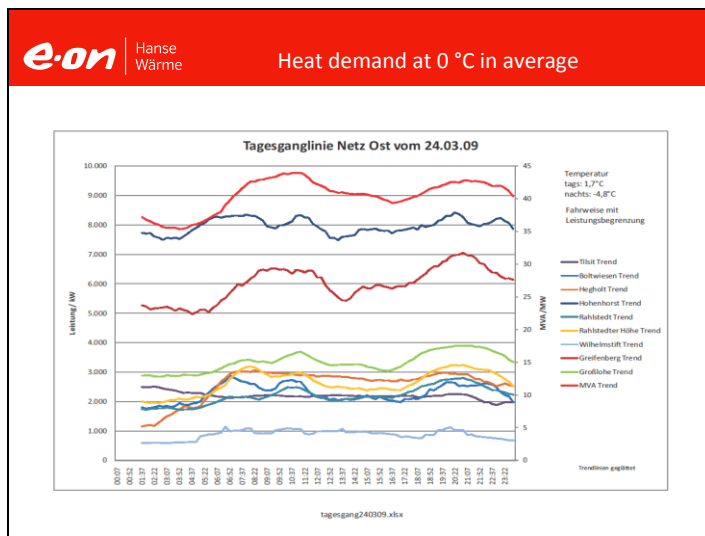


Folie 27

e-on Hanse Wärme Content


1. Overview of the E.ON Hanse Wärme GmbH
2. Renewable energies in the heating market
3. Long-term thermal storage: example Hamburg-Karlshöhe
4. Overcoming of technical obstacles of the solar thermal energy: project 'multifunctional storage'
5. Overcoming of economical obstacles of the solar thermal energy (pilot project Hamburg)
6. Prospect

Seite 27

Folie 28

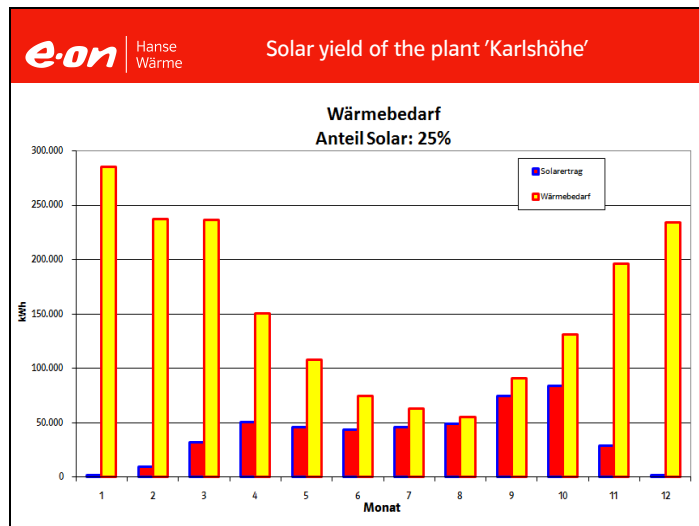

Folie 29

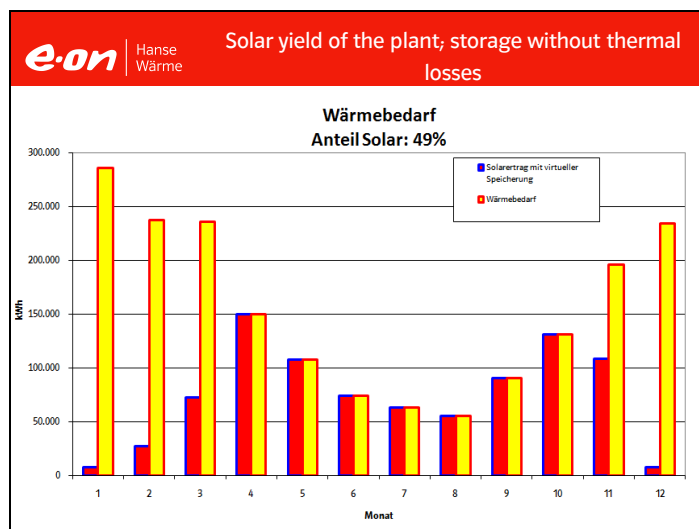

Folie 30

Solar network usage – concept description -

- The solar collectors in a standardised performance are connected to the network by heat exchangers. The feed-in is normally connected to the flow. The average temperature of the return water is 55 to 60 °C.
- Internal heat storage in the building and the required control systems are not necessary. Compared to conventional solarthermal systems, this technique reduces the investment.
- The amount of heat fed into the network can be released from storage when- or wherever it is required via a supplier's service installation.
- Feed-in and withdrawal will be credited within one balance sheet (8 months from April to November).

Seite 10

e-on | Hanse Wärme | Solar network usage – concept description -

Examples:


1. A building, equipped with a solar collector, is connected to the network. The solar heating yield is fed into the network and will be credited in the balance sheet.
2. A building, equipped with a solar collector, is connected to the network. Another connected building is supplied virtually by the solarthermal energy. This building can have a different owner. The heat yields and demands are credited in the balance sheet within the balance period.

Seite 31

e-on | Hanse Wärme | Solar network usage - balance sheet -

Example for particular case	feed-in	delivery
Solar collector surface	150 m ²	
Peak power	75 kW	
Heat yield	60 MWh	
Electricity consumption feed-in	300 kWh	
Balance period (months)	8	
Share of heat yield	89 %	
Heat network feed-in	53 MWh	
Thermal power (-12 °C)		100 kW
Heat demand of the building		180 MWh
Within the balance period		90 MWh
Share of solar energy		29,7%
Primary energy factor		
Network	70,3%	0,70
Solar	29,7%	0,00
In total		0,49

Seite 32

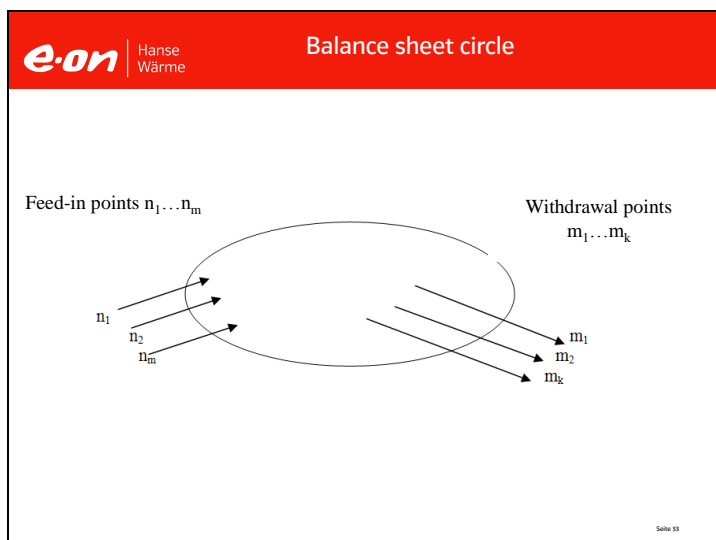

Folie 34

e-on | Hanse Wärme

Solar network usage - payment -

- The connection of a solar thermal collector to the network is usually covered by the fixed price [€ p.a.] for the supplied buildings.
- Access to the system, consisting of network, pumps, heat losses, virtual storage, balance sheet etc., is offered for 5,- € / MWh.
- The metering-point of the feed-in is charged with 60 € p.a. (until 100 kW)
- The heat amount fed into the network will be completely credited.

Solie 34

Folie 35

e-on | Hanse Wärme

Advantages of the solar network usage concept

- In a customer-to-customer relation, the price for internal heating storage is covered by the system payment of 5,- € / MWh, which is less expensive than the internal storage.
- The variable gross margin of solar thermal energy for heating requirement is maximized up to 50%.
- The primary energy factor of a residential building can be improved in addition to the key figure [$f_{PE,DH} = 0,60$] of the network.
- Efficient roof orientations and building situations can be used. The solar collectors are getting independent of the building which has to be redeveloped.

Solie 35

Folie 36

e-on | Hanse Wärme

Advantages of the solar network usage concept

- Apart from the fact that there is a low heat loss in the collector circle all the solar heat can be used. The losses of the storage are marginal while those of the network are constant.
- The solar heat is covering the network heat losses in summer, will be stored virtually or will be delivered directly to the customer.
- In the balance sheet network heat losses will be ignored.
- Due to the new double insulation, the heat loss in the 4.000 m³-storage is practically zero.

Solie 36

Folie 37

e-on | Hanse
Wärme

Content

1. Overview of the E.ON Hanse Wärme GmbH
2. Renewable energies in the heating market
3. Long-term thermal storage: example Hamburg-Karlshöhe
4. Overcoming of technical obstacles of the solar thermal energy: project 'multifunctional storage'
5. Overcoming of economical obstacles of the solar thermal energy (pilot project Hamburg)
6. Prospect

Seite 17

Folie 38

e-on | Hanse
Wärme

Prospect

- The projects 'multifunctional storage system' and 'glass energy house' are a contribution to 'Green Capital' Hamburg 2011.
- Other models for network usage of heat from renewable energies are in development.
- E.ON Hanse Wärme plans to reduce its CO₂-emissions for heat supply from 120 g / kWh to less than 100 g / kWh in 2015. Back in 1990, the emissions were > 260 g CO₂ / kWh.

Seite 18

Folie 39

e-on | Hanse
Wärme

Thank you for your attention!